


## 18. WPMZ-6 Control flow rate of the cooling circulation device

**Outputs the difference calculation result to the PLC / controller**

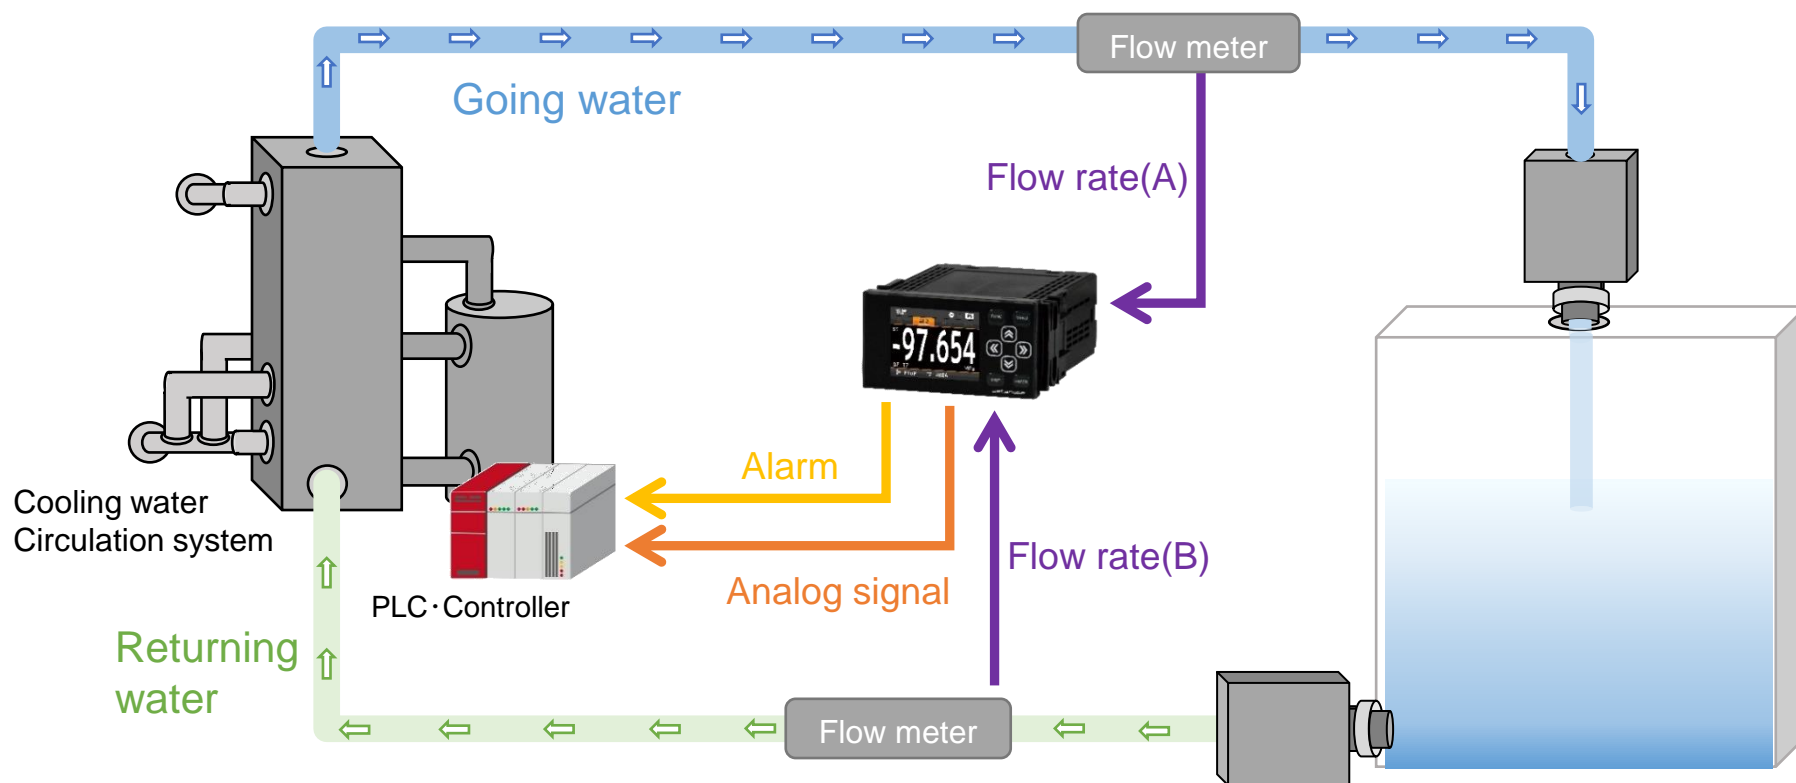

**Adjustment operation such as changing the alarm level  
can be easily performed on site.**